



Order Number

Serial Number

Number in Batch

PRODUCT TEST MANUAL

2HSA517K4

125 V ER RESET MULTI-TRIP RELAY 2M+18B

Issue Level	Date	Summary of changes
A	05/04/2006	Initial issue.
B	17/08/2010	Update to include operate current test
C	17/06/2011	Update to 10ms operate time

Due to RMS continuous product improvement policy this information is subject to change without notice.
This document is uncontrolled and subject to copyright.

Author	Checked & Registered	.pdf file created	Released
ERL	DW	DW	



1. ASSOCIATED DRAWINGS

Reyrolle Drawing 2112W50139
PCI 145 ALPHA Reference Build specification
PL201 Sample Inspection Plan

2. HIGH VOLTAGE TESTING

Before carrying out these tests ensure that the relay has been manually latched on. Due to the number of break contacts these will create a short circuit for the high voltage tester if left in their normally closed state.

Using the standard Matrix High Voltage test fixture apply 2KV RMS 50Hz between terminals as in 2.a), 2.b) below.

Repeat the test using three 5KV 1/50us pulses of each polarity between terminals as in 2.a), 2.b) below.

- a) All terminals together to frame
- b) Coil to all contacts plus frame

3. TEST PROCEDURE

a) Determine the sample size for the batch by referring to the Sample Plan on PL 201. Select the samples at random from the batch and check that the minimum and maximum contact gap meets the requirements of PCI 145, using feeler gauges measure the contact gap on all contacts on all contact stacks, measure the contact pressures on blades that are accessible.

Check

b) Manually operate the relay to its latched position, push the armature towards the pole face of the relay. Ensure that a minimal amount of backlash is present and that the contacts have sufficient over travel by ensuring that all of the contacts have made before the armature is fully latched.

Check

c) Plug the relay into the Matrix Test panel.

d) Adjust the auxiliary supply to 120% of nominal (150 VDC)

e) Operate the "CRO & Cap Discharge" switch to on, push "High Speed Relay" button. Ensure that the relay does not operate or the contacts make, a slight flicker is acceptable.

Check

f) Connect the coaxial lead from "CH2 Trigger" on the test jig to the external trigger input on the Oscilloscope; connect the "CH1" lead on the test jig to channel 1 input on the oscilloscope. Set the time base to 2 ms. Press the "Start" button and note the waveform on the oscilloscope, the time from the trigger point to the rising edge (N/O contacts) of the waveform on first touch is 10 mS for switch positions 1, 2. For positions 3 to 20 the falling edge (N/C contacts) of the waveform is less than 10 ms.

Check

g) Make sure that the contact wiring of the relay corresponds to the connection diagram on the side of the relay.

Check

h) Check that the relay operates satisfactorily at 120% (150V) and 50% (62.5V DC) and that the armature is fully home and the latch pin is through the hole in the latch blade.

Check



i) Check that the relay can be electrically reset by applying 50% (62.5 volts) of nominal to terminals 25 & 26

Check

j) Reduce the auxiliary input voltage to zero then bring the voltage slowly back to nominal, watch the current reading on the power supply meter. Note the current at which the relay operates, this must be greater than 100mA.

Check

k) Ensure that the operate burden is reduced by the economising element after the relay has operated.

Check

4. GENERAL & FUNCTIONAL

a) Plug the "Alpha 20 contact" test jig into the test rack and plug in the test relay, insert the .030" gauge and slowly operate the armature by hand and note when each of the front panel LEDs illuminate. All LEDs should be on by the time the armature is against the gauge.

b) Fit flag retaining clip to the flag to prevent damage to the flag mechanism during transport.

c) Check that the relay is electrically sound and mechanically robust as per Standard Inspection & Test Schedule 903-000-026.


Check

PASS

TESTED BY: _____ DATE: _____

5. TEST SETUP & WAVEFORMS

CONTACT TEST SETUP

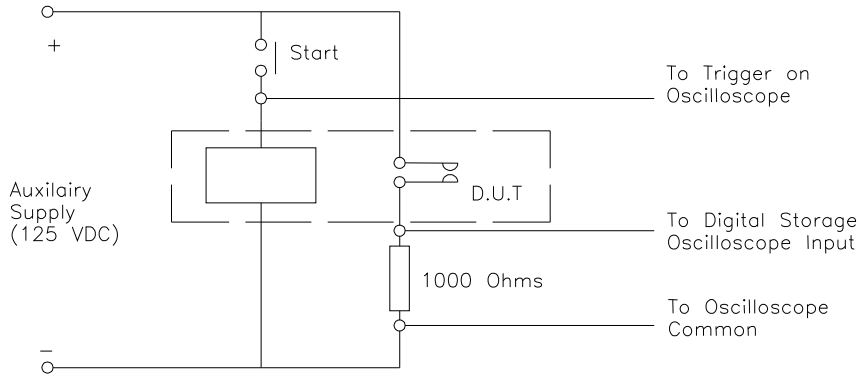

Contact Test Setup. Pictorial representation shown actual schematic contains switches and various components.

CONTACT OPERATE WAVEFORMS

Below are the "Ideal" waveforms to indicate the difference between the N/O & N/C contacts

