




# *2V75K14 Test Manual*


## *Three Phase Metrosil Module*

relay monitoring systems pty ltd

---

### **Advanced Protection Devices**

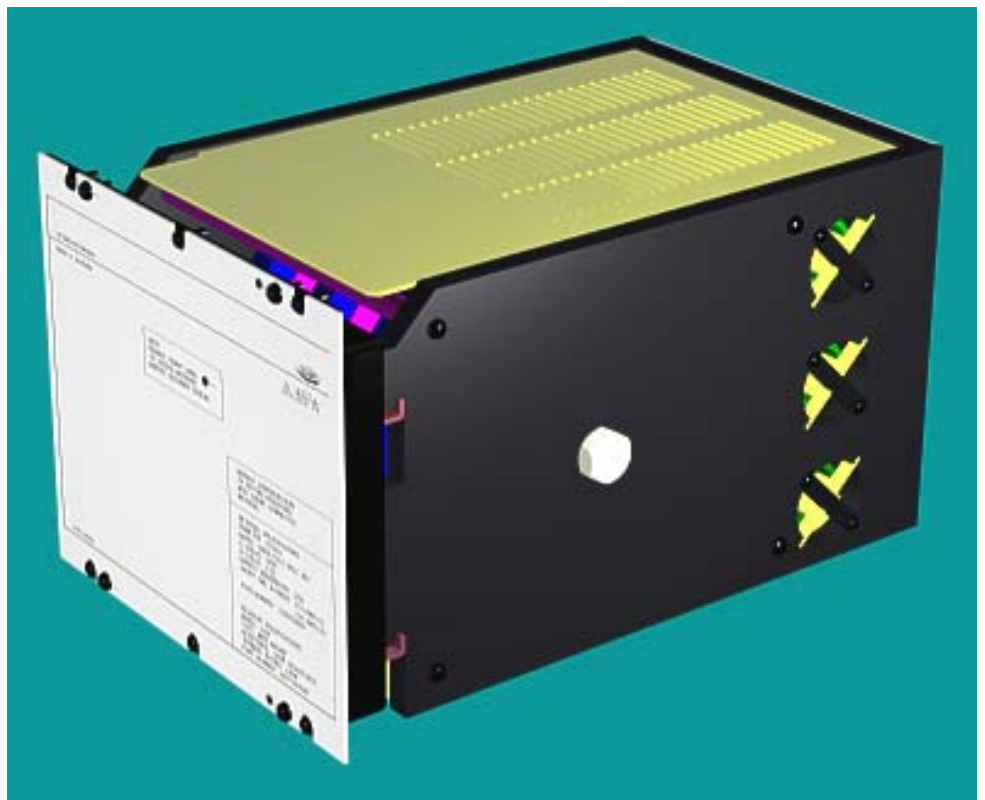

 User Guide

 Test Manual

# 2V75K14 Test Manual

## Links to Other Documents

---

User Guide: [http://www.rmspl.com.au/userguide/2V75\\_user\\_guide.pdf](http://www.rmspl.com.au/userguide/2V75_user_guide.pdf)

## Test Certification

---

This is to certify that the equipment detailed below has been manufactured, inspected & tested in accordance with a Quality System which complies with the requirements of AS/NZS ISO9001-2000.

Order Number	Serial Number

Only valid when the "Passed" box has been signed off by Production Personnel.

## Version Control

---

Issue	Date	Summary of changes
A	21/06/2005	Initial issue.

Due to RMS continuous product improvement policy, this information is subject to change without notice.  
This document is uncontrolled and subject to copyright.

Author	Checked & Registered	.pdf file created	Released
DG	ARF	DG	



**1.0 HARDWARE SPECIFICATIONS – 2V075K14 [A][A][B]**

**1.1 Metrolsil Size**

[A] 152mm (6") Diameter

**1.2 Series Stabilizing Resistors**

[A] Not required

**1.3 Mounting Hardware**

[B] Surface mount

**1.4 Non-Standard Features**

Hardware specifications not described in Data Sheet.

None



**2.0 TEST PROCEDURE**

**2.1 Test Equipment Required**  
 High Voltage Test Equipment.  
 Authorised assembly documents

**2.2 Associated Drawings**  
 165-075-114                   Wiring Diagram  
 165-075-503                 Assembly diagram

**2.3 High Voltage Testing**

- a)     Apply 2KV RMS between the terminal groups as listed in A & B below for 1 minute.
- b)     Apply three 5KV 1/50usec pulses of each polarity as listed in A & B below.


GROUP A	GROUP B
All numbered terminals	Frame

**2.4 Hardware Verification**  
 Verify hardware as to 165-075-503

- a)   Ensure high temp Si wire is used on cct wiring.                    VERIFY
- b)   Ensure rear door opens freely.    VERIFY
- c)   Ensure components are marked as per wiring diagram.            VERIFY
- d)   Check loom is correctly routed and wired.                            VERIFY
- e)   Ensure Metrosil mounts are properly torqued.                        VERIFY
- f)   Ensure all ancillary components are with product.                    VERIFY

PASSED BY	DATE

### 3.0 CONNECTION DIAGRAM

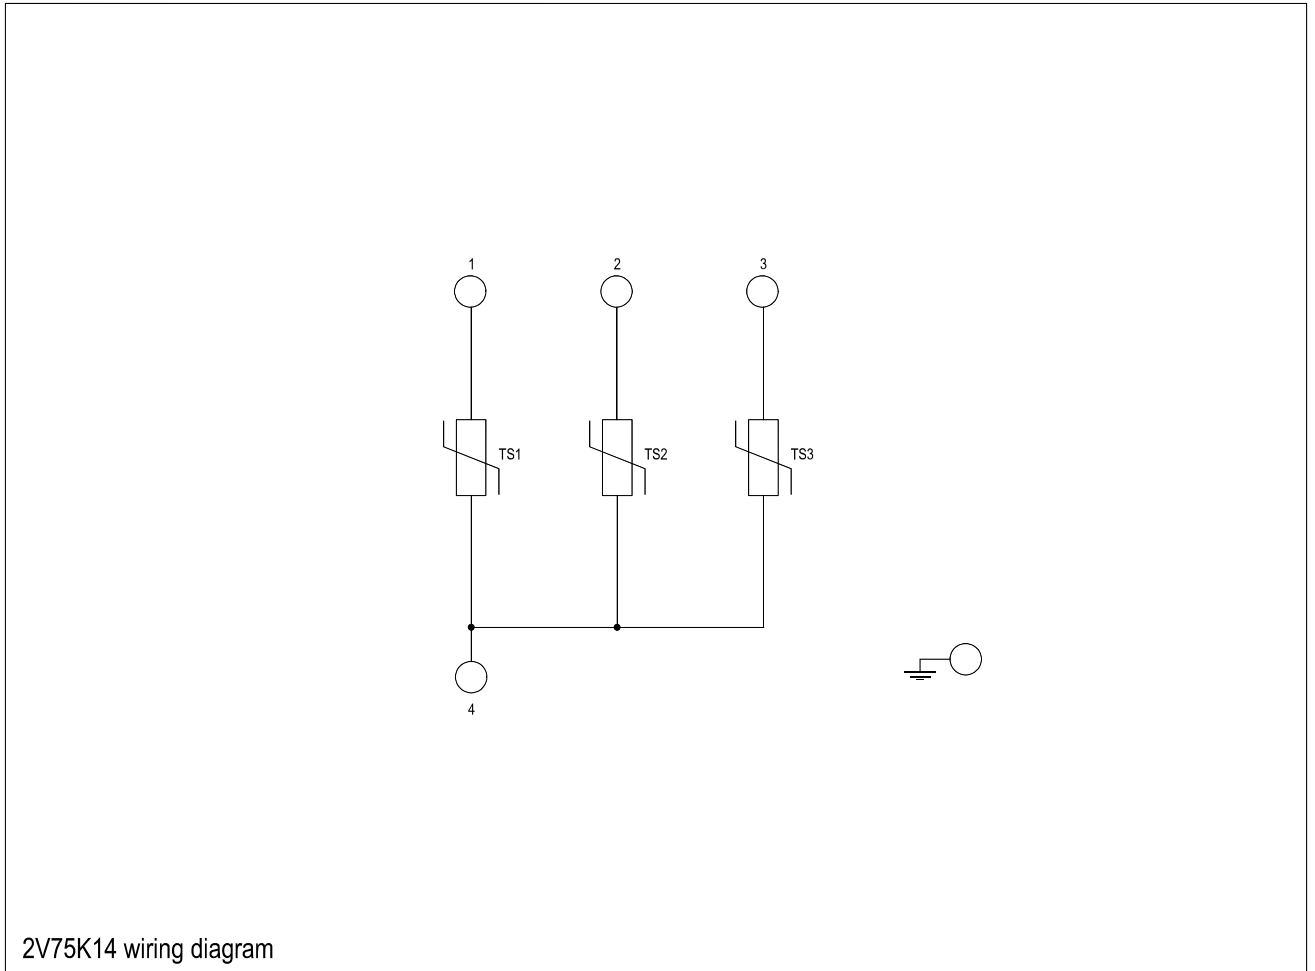

2V75K14 wiring diagram